

CERTIFICATE

of constancy of performance

1922 - CPR - 0991

In compliance with Regulation (EU) 305/2011 of the European Parliament and of the Council of 9 March 2011 (the Construction Products Regulation or CPR), this certificate applies to the construction product

Fire detection and fire alarm systems. Power supply equipment
- teknim TPU-8245 External Power Supply, 24 Volt, 5 Amper

(with the performance listed, see Annex I to 1922-CPR-0991 that is an inseparable part of this certificate)

placed on the market under the name or trade mark of

Bilgi Elektronik San. ve Tic. A.Ş.

Dudullu Organize Sanayi Bölgesi 1. Cadde İsmet Tarman İş Merkezi No:1, Kat:2
D.32 Ümraniye, İstanbul, Turkey

and produced in the manufacturing plant of

Bilgi Elektronik San. ve Tic. A.Ş.


Dudullu Organize Sanayi Bölgesi 1. Cadde İsmet Tarman İş Merkezi No:1, Kat:2
D.32 Ümraniye, İstanbul, Turkey

This certificate attests that all provisions concerning the assessment and verification of constancy of performance described in Annex ZA of the standard

EN 54-4:1997, EN 54-4:1997/A1:2002, EN 54-4:1997/A2:2006, EN 54-4:1997/AC: 1999

under system 1 for the performance set out in this certificate are applied and that the factory production control conducted by the manufacturer is assessed to ensure the constancy of performance of the construction product.

This certificate was first issued on 02.04.2018 and will remain valid until 28.11.2023 as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body. The certificate is supported through annual surveillance audit and is reissued after each surveillance audit. The validity of the certificate may be confirmed in the CE register at the web address www.dedal-bg.net.

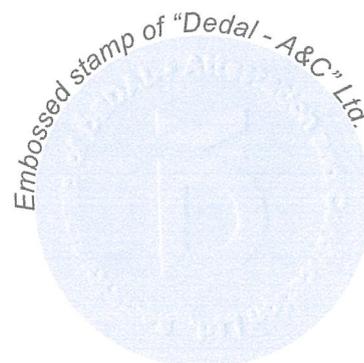

Manager:


Anna Vasileva

ANNEX I TO CERTIFICATE OF CONSTANCY OF PERFORMANCE 1922 - CPR - 0991/23.11.2020

Performance list, acc. to EN 54-4:1997, EN 54-4:1997/A1:2002, EN 54-4:1997/A2:2006, EN 54-4:1997/AC: 1999

Essential Characteristics	Performance	Clause
Performance of power supply		
- General requirements	Pass	4
- Functions	Pass	5
- Materials, design and manufacture	Pass	6
Operational reliability		
- General requirements	Pass	4
- Functions	Pass	5
- Materials, design and manufacture	Pass	6
- Documentation	Pass	7
- Marking	Pass	8
Durability of operational reliability, temperature resistance		
- Cold (operational)	Pass	9.5
Durability of operational reliability, vibration resistance		
- Impact (operational)	Pass	9.7
- Vibration, sinusoidal (operational)	Pass	9.8
- Vibration, sinusoidal (endurance)	Pass	9.15
Durability of operational reliability, electrical stability		
- Electromagnetic compatibility (EMC), immunity tests (operational)	Pass	9.9
Durability of operational reliability, humidity resistance		
- Damp heat, steady state (operational)	Pass	9.6
- Damp heat, steady state (endurance)	Pass	9.14

This certificate was first issued on 02.04.2018 and will remain valid until 28.11.2023 as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body. The certificate is supported through annual surveillance audit and is reissued after each surveillance audit. The validity of the certificate may be confirmed in the CE register at the web address www.dedal-bg.net.

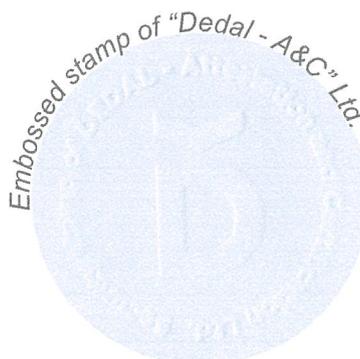

Manager:

Anna Vasileva

Issued:
Burgas, 23 November 2020

dipl. eng. Anna Vasileva